
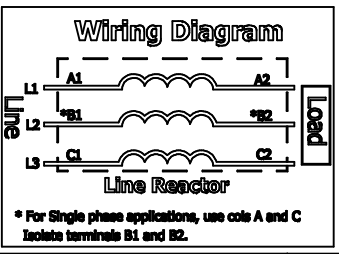
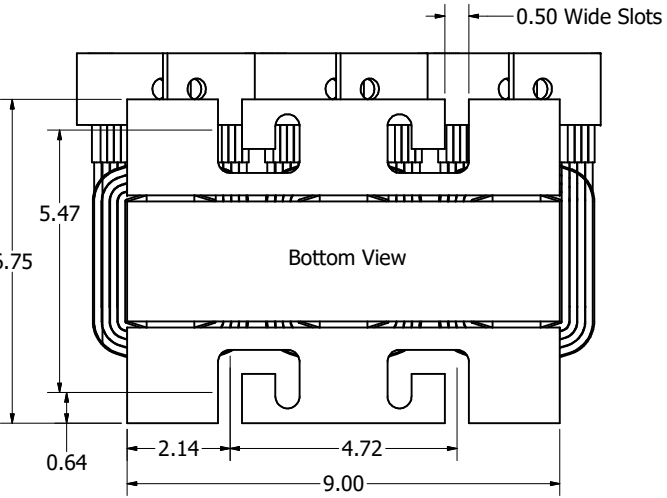
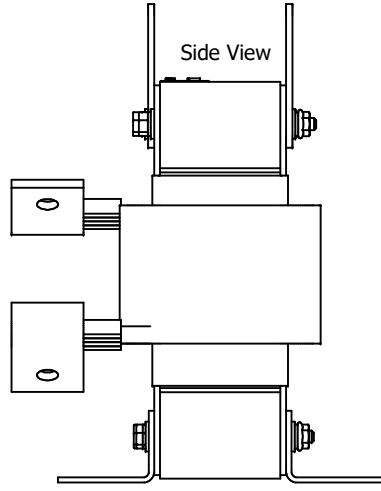
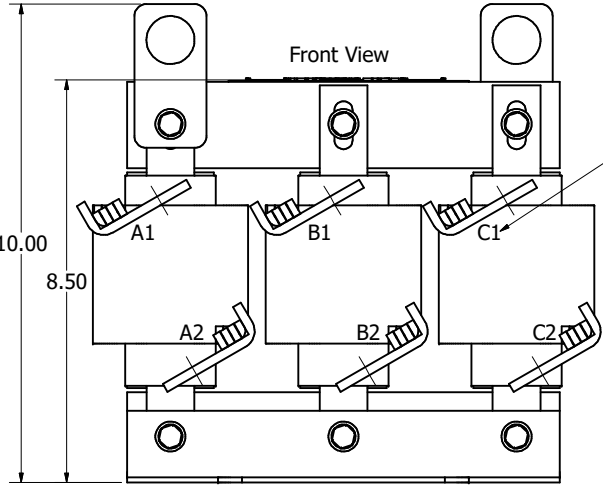


480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG3L	200	240	240	83.9	280	65	SLK12	0.44

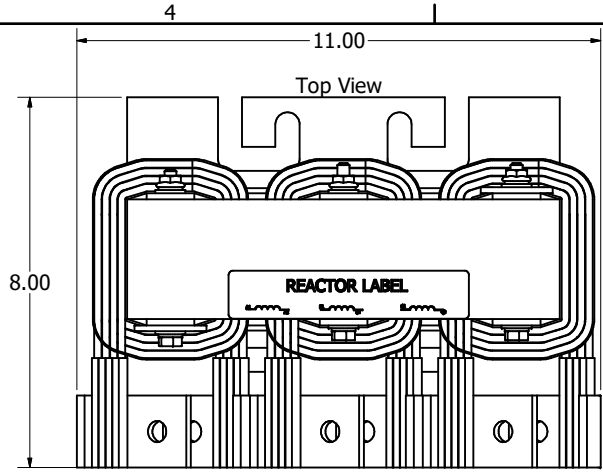

**TCI, LLC**  
Germanstown, WI, USA.  
transcoil.com  
800-824-8282

**(800) 824-8282 transcoil.com**

**KDRUL Drive Reactor**  
KDR- Motor Amps ---  
3PH, 50/60Hz, ---V Rated, 600V Max, -A Max  
40C Amb Max, 155C Rise, RoHS  
Manual #30895 LUG KIT #SLK---

DATE CODE

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
  2. UL file number: cULus Listed File E116124.
  3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  4. KDR IOM Manual Part Number 30895
  5. Material(s) Shall be RoHS Compliant
  6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)		<b>TCI</b> W132N10611 (Rev 11/20) Germanstown, WI 53022 © 2024 TCI, LLC	
				DECIMAL		An Official Motors Company KDR G Frame, Copper Bus	
				.XX ± .25		Reactor Drawing	
				.XXX ± .10		DRN BY: DSW    DATE: 6/24/2024    107533-20	
				FRACTIONAL		SCALE: 1/2    DRVD:    CDR:    SHEET 1 OF 1	
				± 1/32			
				ANGULAR			
				± 1°			
A	107533-3 to 107533-20	6/24/2024	DSW				
NO	REVISION	DATE	BY				