
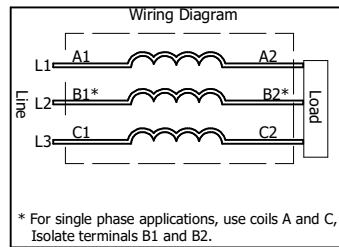
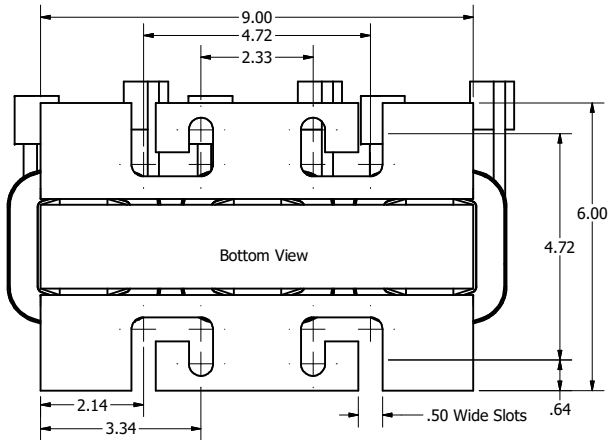
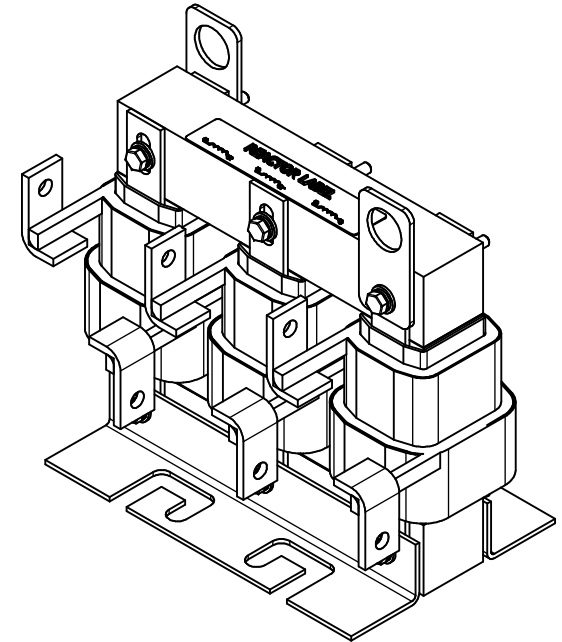
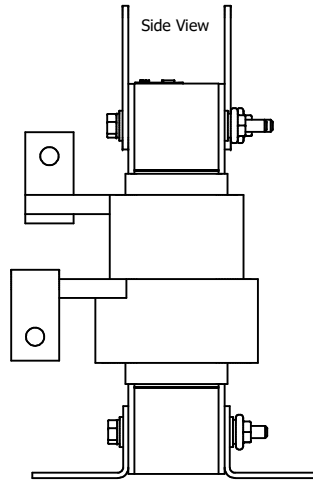
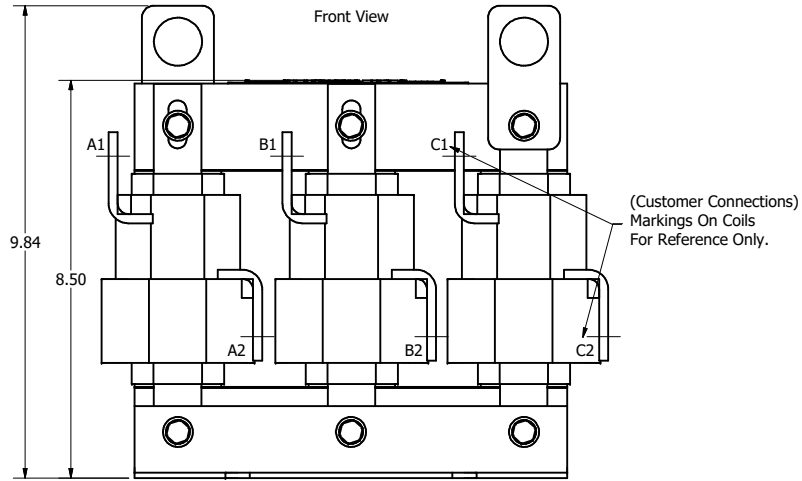


575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDR142L	200	192	192	146	50	342	SLK11	0.38

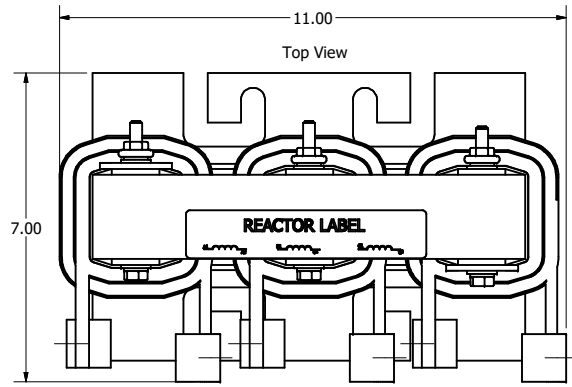

TCI (800) 824-8282 transcoil.com

TCL, LLC
Garrettsville, WI, USA
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDR— Motor Amps —
300, 300/400, —1/1 Rated, 600V Max, —A Max
400 Amp Max, 155C Rise, Rept'd
Manual #30895 LUG KIT #SLK—

UL LISTED CE
200-0000-10-1000 © 2022 TCI, LLC

DATE CODE A1 B1 C1

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. For KDRUL Version With Terminal Lugs Attached, See Sheet 9
 3. UL file number: cULus Listed File E116124.
 4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 5. KDR IOM Manual Part Number 30895
 6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 7. Material(s) Shall be RoHS Compliant
 8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	SCALE
B	5937, Added lift rings	5/24/22	JSG	

TCL W132N10611 (Rev. 11/16) Garrettsville, WI 53022 © 2022 TCI, LLC

An Official Motors Company
KDR I Frame, Copper Bus
Reactor Drawing
107535DG

DRN BY: BSW DATE: 2/28/18
SCALE: 1/2 DRAWN BY: CSE

4

3

2

1

4

3

2

1